
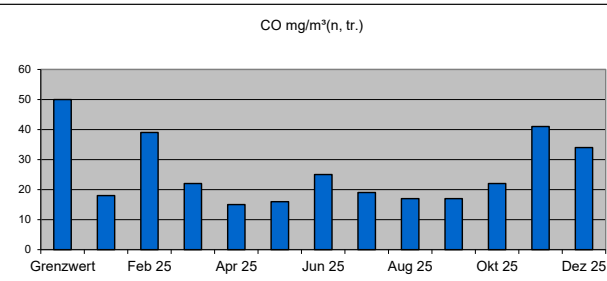
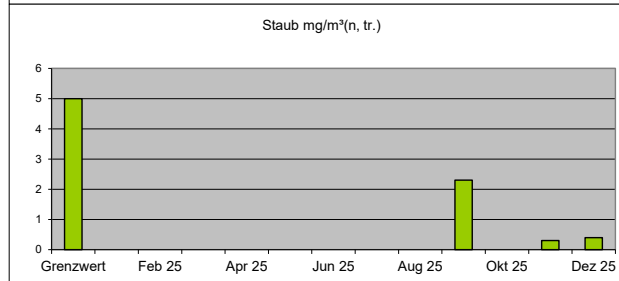
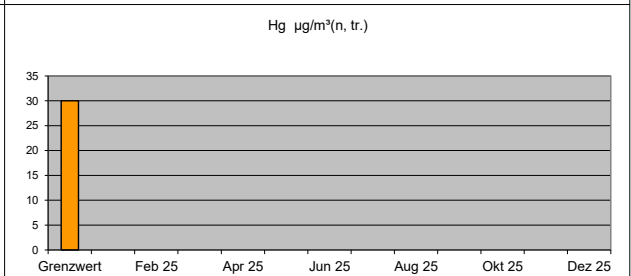
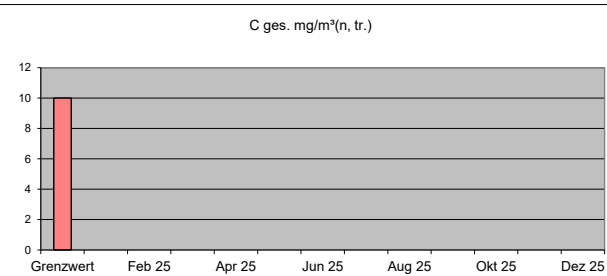
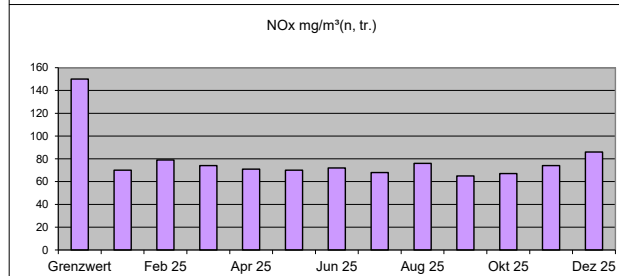
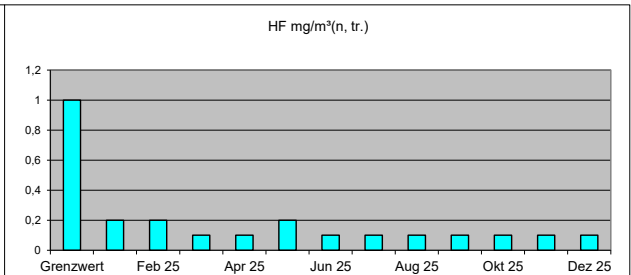
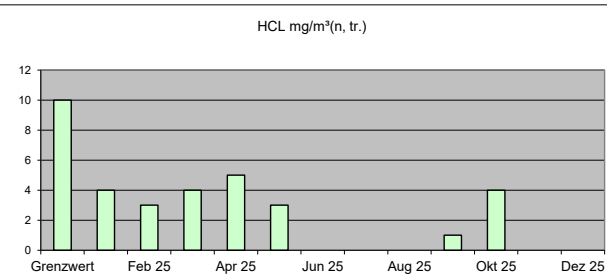


Jahresprotokoll Normierte Werte als Monatsmittelwerte

	SO ₂		HCL		HF		NO _x		C ges.		Hg		Staub		CO	
	mg/m ³ (n, tr.)		mg/m ³ (n, tr.)		mg/m ³ (n, tr.)		mg/m ³ (n, tr.)		mg/m ³ (n, tr.)		µg/m ³ (n, tr.)		mg/m ³ (n, tr.)		mg/m ³ (n, tr.)	
Grenzwert	50	min./max.	10	min./max.	1	min./max.	150	min./max.	10	min./max.	30	min./max.	5	min./max.	50	min./max.
Jan 25	6,0	0/23	4,0	2/7	0,20	0,1/0,2	70,00	54/97	0,00	0/0	0,00	0/0	0,00	0/0	18,00	1/40
Feb 25	3,0	0/15	3,0	1/5	0,20	0,2/0,2	79,00	66/95	0,00	0/0	0,00	0/0	0,00	0/0	39,00	25/49
Mrz 25	3,0	0/15	4,0	2/7	0,10	0,1/0,2	74,00	58/93	0,00	0/0	0,00	0/0	0,00	0/0	22,00	9/35
Apr 25	6,0	0/13	5,0	3/8	0,10	0,1/0,2	71,00	49/91	0,00	0/0	0,00	0/0	0,00	0/0	15,00	4/30
Mai 25	3,0	0/9	3,0	1/6	0,20	0,1/0,2	70,00	61/82	0,00	0/0	0,00	0/0	0,00	0/0	16,00	7/45
Jun 25	1,0	1/13	0,0	0/0	0,10	0,1/0,1	72,00	59/112	0,00	0/0	0,00	0/0	0,00	0/0	25,00	8/46
Jul 25	3,0	0/8	0,0	0/0	0,10	0,1/0,1	68,00	50/88	0,00	0/0	0,00	0/0	0,00	0/0,3	19,00	6/44
Aug 25	2,0	0/13	0,0	0/1	0,10	0,1/0,1	76,00	64/94	0,00	0/0	0,00	0/0	0,00	0,0/0,2	17,00	6/48
Sep 25	6,0	0/14	1,0	0/4	0,10	0,1/0,1	65,00	49/81	0,00	0/0	0,00	0/0	2,30	0/4,9	17,00	6/25
Okt 25	7,0	1/24	4,0	0/16	0,10	0,1/0,1	67,00	52/103	0,00	0/0	0,00	0/0	0,00	0/0,1	22,00	7/51
Nov 25	2,9	0/42	0,0	0/0	0,10	0,1/0,1	74,00	52/92	0,00	0/0	0,00	0/0	0,30	0,0/0,5	41,00	4/65
Dez 25	0,0	0/1	0,0	0/0	0,10	0,1/0,1	86,00	72/108	0,00	0/0	0,00	0/0	0,40	0,2/0,8	34,00	20/49

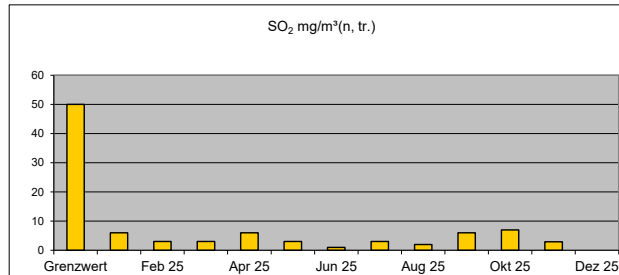

Emissionswerte als Monatsmittelwerte für
Dezember 2025
06.01.2026
Kraftwerksleiter Jörg Dobbrunz