
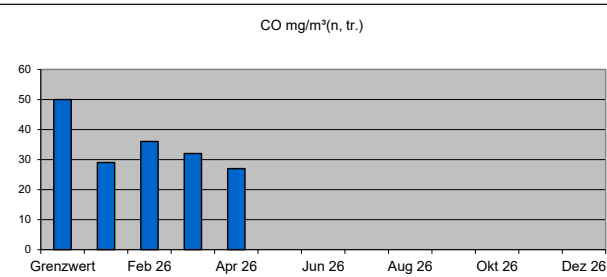
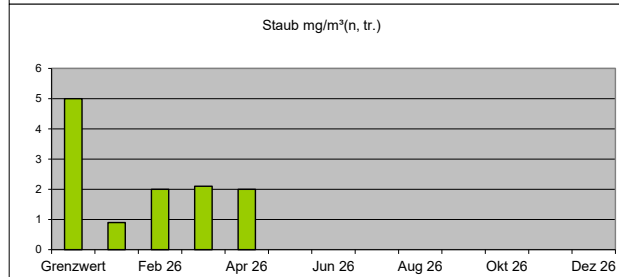
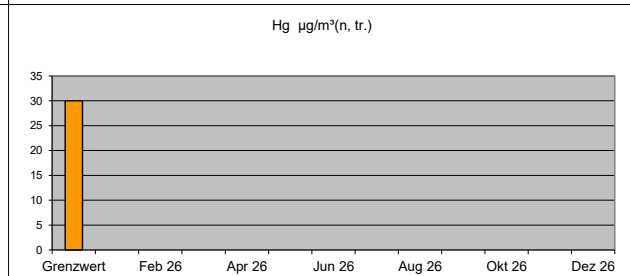
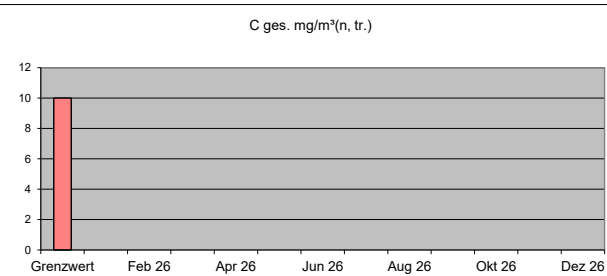
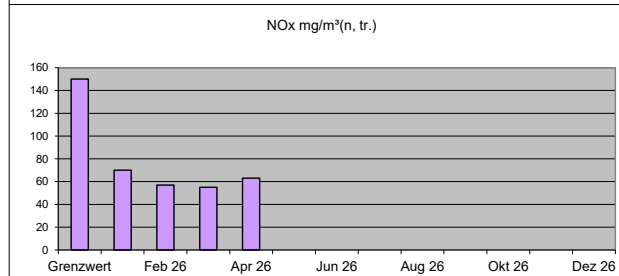
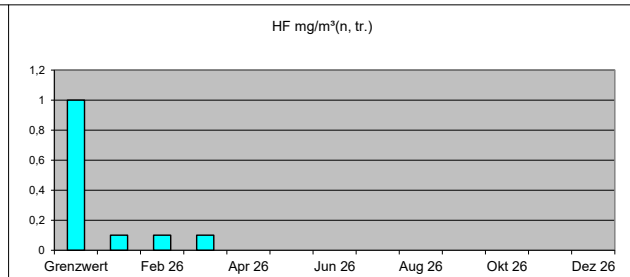
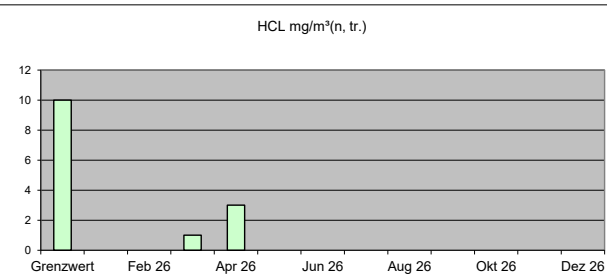


Jahresprotokoll Normierte Werte als Monatsmittelwerte

	SO ₂		HCL		HF		NO _x		C ges.		Hg		Staub		CO	
	mg/m ³ (n, tr.)		mg/m ³ (n, tr.)		mg/m ³ (n, tr.)		mg/m ³ (n, tr.)		mg/m ³ (n, tr.)		µg/m ³ (n, tr.)		mg/m ³ (n, tr.)		mg/m ³ (n, tr.)	
Grenzwert	50	min./max.	10	min./max.	1	min./max.	150	min./max.	10	min./max.	30	min./max.	5	min./max.	50	min./max.
Jan 26	5,0	0/23	0,0	0/11	0,10	0,01/0,1	70,00	49/106	0,00	0/0	0,00	0/0	0,90	0,0/2,5	29,00	15/45
Feb 26	5,0	0/19	0,0	0/0	0,10	0,1/0,1	57,00	47/75	0,00	0/0	0,00	0/0	2,00	1,7/2,3	36,00	14/50
Mrz 26	7,0	0/21	1,0	0/5	0,10	0,1/0,1	55,00	45/69	0,00	0/0	0,00	0/0	2,10	1,8/2,5	32,00	21/43
Apr 26	17,0	7/28	3,0	1/6	0,00	0,1/0,1	63,00	53/87	0,00	0/0	0,00	0/0	2,00	1/2,4	27,00	18/41
Mai 26	0,0	0/0	0,0	0/0	0,00	0/0	0,00	0/0	0,00	0/0	0,00	0/0	0,00	0/0	0,00	0/0
Jun 26	0,0	0/0	0,0	0/0	0,00	0/0	0,00	0/0	0,00	0/0	0,00	0/0	0,00	0/0	0,00	0/0
Jul 26																
Aug 26																
Sep 26																
Okt 26																
Nov 26																
Dez 26																

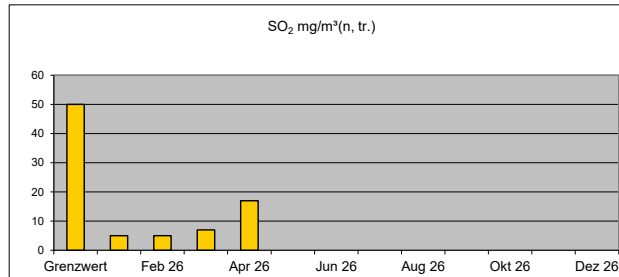

Emissionswerte als Monatsmittelwerte für
Mai 2026
01.07.2026
Geschäftsführer Jörg Dobbrunz