


Jahresprotokoll Normierte Werte als Monatsmittelwerte

	SO ₂		HCL		HF		NO _x		C _{ges} *		Hg		Staub		CO	
	mg/m ³ _(n, tr.)		mg/m ³ _(n, tr.)		mg/m ³ _(n, tr.)		mg/m ³ _(n, tr.)		mg/m ³ _(n, tr.)		µg/m ³ _(n, tr.)		mg/m ³ _(n, tr.)		mg/m ³ _(n, tr.)	
Grenzwert	50	min./max.	10	min./max.	1	min./max.	150	min./max.	10	min./max.	30	min./max.	5	min./max.	50	min./max.
Jan 21	0,0	0/2	0,0	0/2	0,20	0,2/0,3	70,00	45/96	0,00	0/1	0,00	0,0/2,0	0,00	0,0/0,2	16,00	5/36
Feb 21	4,0	0/17	0,0	0/1	0,30	0,2/0,3	60,00	39/116	0,00	0/2	0,00	0/0	0,30	0/1,3	30,00	9/52
Mrz 21	3,0	0/11	0,0	0/1	0,30	0,2/0,3	57,00	44/68	0,00	0/0	0,00	0/0	0,40	0,0/2,1	31,00	23/39
Apr 21	5,0	0/20	0,0	0/1	0,20	0,2/0,3	58,00	0,50	0,00	0/0	0,00	0/0	0,20	0/0,9	19,00	8/44
Mai 21																
Jun 21																
Jul 21																
Aug 21																
Sep 21																
Okt 21																
Nov 21																
Dez 21																

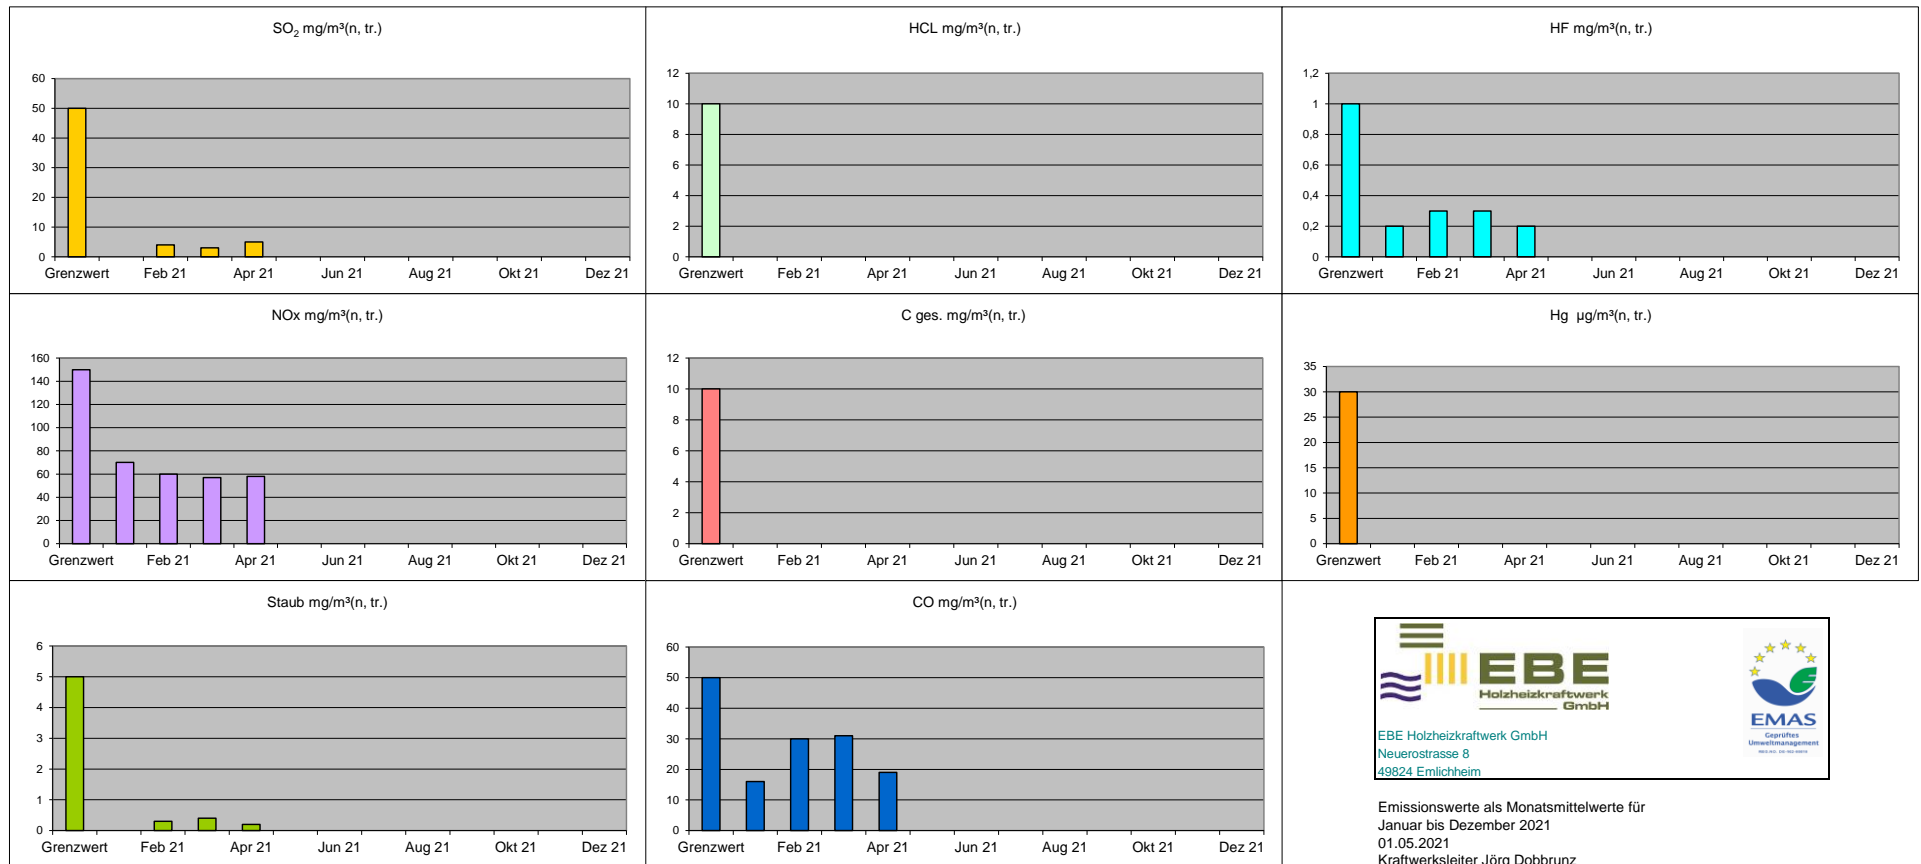

Emissionswerte als Monatsmittelwerte für
Januar bis Dezember 2021
01.05.2021
Kraftwerksleiter Jörg Dobbrunz