


Jahresprotokoll Normierte Werte als Monatsmittelwerte

	SO <sub>2</sub>		HCL		HF		NO <sub>x</sub>		C ges.		Hg		Staub		CO	
	mg/m <sup>3</sup> (n, tr.)		mg/m <sup>3</sup> (n, tr.)		mg/m <sup>3</sup> (n, tr.)		mg/m <sup>3</sup> (n, tr.)		mg/m <sup>3</sup> (n, tr.)		µg/m <sup>3</sup> (n, tr.)		mg/m <sup>3</sup> (n, tr.)		mg/m <sup>3</sup> (n, tr.)	
Grenzwert	50	min./max.	10	min./max.	1	min./max.	150	min./max.	10	min./max.	30	min./max.	5	min./max.	50	min./max.
Jan 25	6,0	0/23	4,0	2/7	0,20	0,1/0,2	70,00	54/97	0,00	0/0	0,00	0/0	0,00	0/0	18,00	1/40
Feb 25	3,0	0/15	3,0	1/5	0,20	0,2/0,2	79,00	66/95	0,00	0/0	0,00	0/0	0,00	0/0	39,00	25/49
Mrz 25	3,0	0/15	4,0	2/7	0,10	0,1/0,2	74,00	58/93	0,00	0/0	0,00	0/0	0,00	0/0	22,00	13028,00
Apr 25																
Mai 25																
Jun 25																
Jul 25																
Aug 25																
Sep 25																
Okt 25																
Nov 25																
Dez 25																

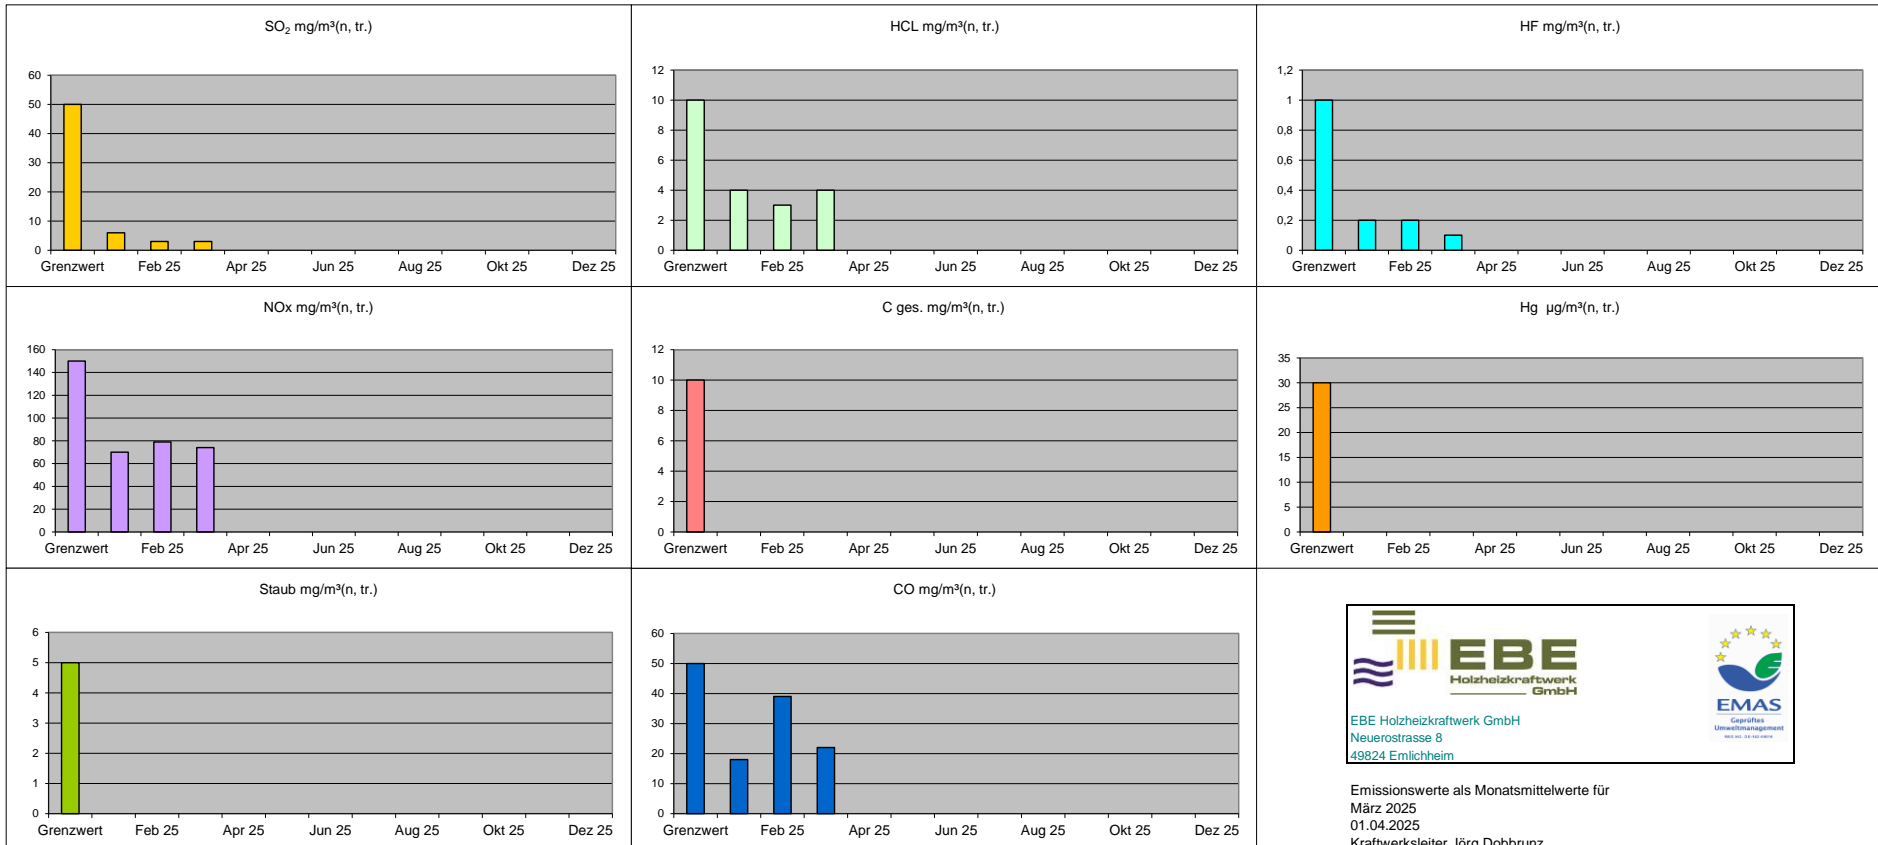

Emissionswerte als Monatsmittelwerte für  
März 2025  
01.04.2025  
Kraftwerksleiter Jörg Dobbrunz